

A-3370 USA

493033702

Aplicue metálico. Apto para uso exterior.


Metallic wall sconce. Suitable for outdoor use.




850°

IP
65

Ø 220 mm
8.5/8"



Ø 120 mm
4.3/4"



97.5 mm
3.7/8"

**UL 1598 ELECTRICAL INSTRUCTIONS FOR FLUSHMOUNTS, WALL SCONCES AND PENDANTS**

SAVE THESE INSTRUCTIONS. MIN 90C SUPPLY CONDUCTORS. CAUTION - RISK OF FIRE. USE STATED WATT OR SMALLER. CAUTION-RISK OF SHOCK. DISCONNECT POWER BEFORE SERVICING. TO REDUCE THE RISK OF A BURN DURING RELAMPING, ALLOW THE BULB TO COOL DOWN. SUITABLE FOR DRY LOCATIONS ONLY. THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARD INVOLVED.

WARNING: ALL WIRES AND WIRE NUTS USED IN THE INSTALLATION MUST BE RATED 195F (90°C). FOR INDOOR USE ONLY. THESE PRODUCT MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN.

Instrucciones / Assembly instructions**Atención: / Warning:**

No mirar directamente a los LED.


Do not look directly into any LED source

Bitte nicht direkt in die LED schauen

Ne regardez jamais les ampoules LED directement

1- Desenroscar los tornillos laterales del tapapared (A). Liberar la sujeción (B). Figura 1.

1- Unscrew the lateral screws from the canopy (A). Remove the mounting bracket (B). Fig.1

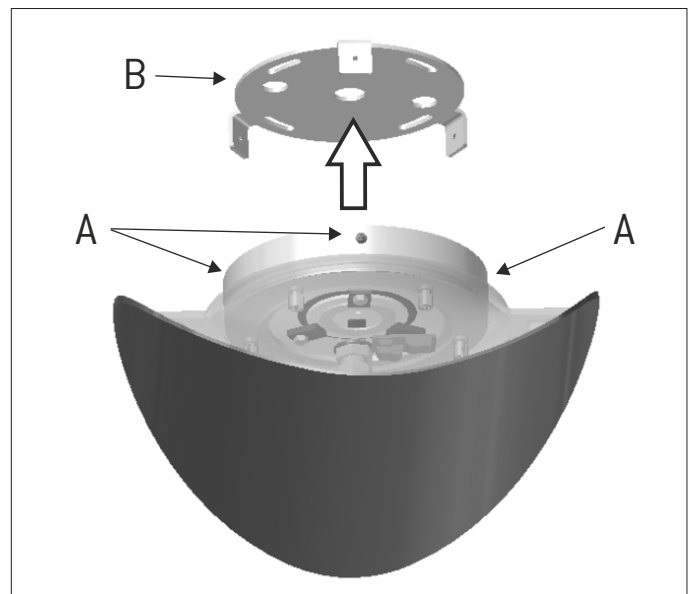
1

Instrucciones / Assembly instructions

2- Pasar los cables eléctricos hacia el interior de la sujeción [B]. Realizar las conexiones correspondientes. Atornillar la sujeción [B] a la pared o en la caja de conexiones. Figura 2.

2- Insert the electrical wires into the mounting bracket [B]. Connect the wires to the electrical junction box, making sure the ground wire is properly connected. Screw the mounting bracket to the wall or the electrical junction box. Figure 2.

2

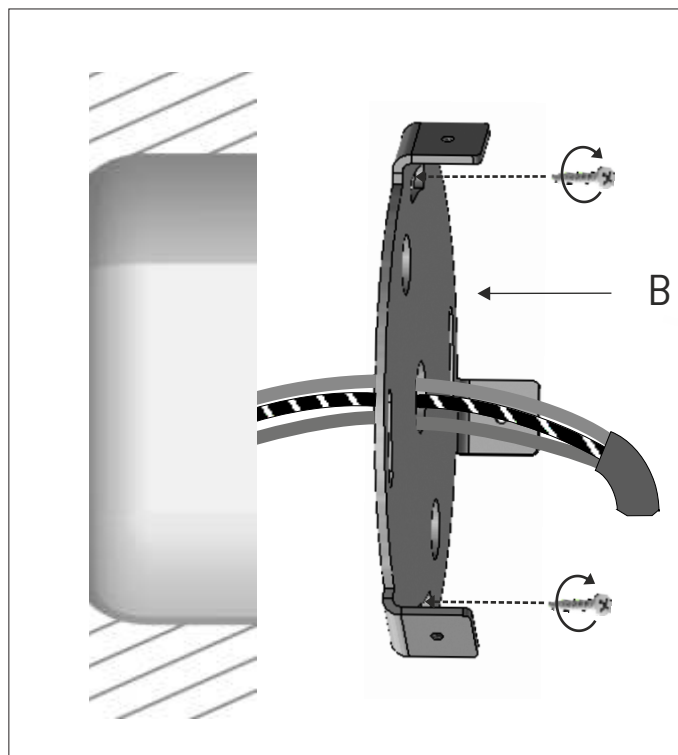

3- Acoplar la lampara a la sujeción [B]. Colocar y enroscar los tornillos laterales del tapapared (A) liberados previamente. Figura 3.

3- Affix the lamp to the mounting bracket [B]. Tighten the lateral screws removed previously back into the canopy [A]. Figure 3.

3

