


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:26.907V I:0.3003A P:8.0811W PF:1.0000 Freq:0Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:787.438x1 lm


NAME: 7822-6500K	TYPE: Surface-mounted Luminaire	HEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 97.44 lm/W
MODEL		Imax(cd)	315.4	S/MH(C0/180)	1.21	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	1.21	
RATED VOLTAGE(V)	28	TOTAL FLUX(lm)	787.44	η UP,DN(C0-180)	0.0,49.2	
NOMINAL FLUX(lm)	787.438	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.7	
LAMPS INSIDE	1	η up(%)	0.1	CIBSE SHR NOM	1.25	
TEST VOLTAGE(V)	28	η down(%)	99.9	CIBSE SHR MAX	1.35	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

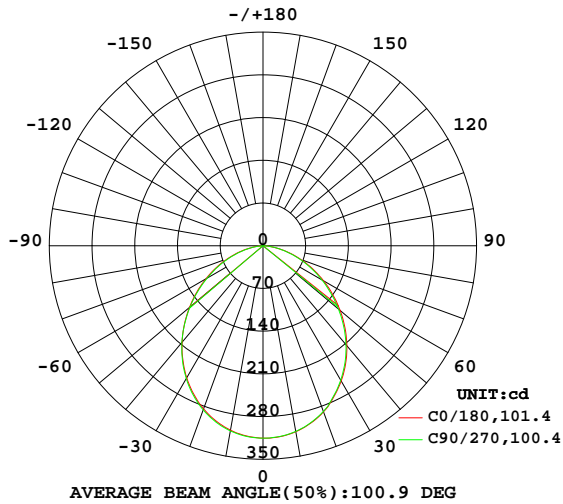

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

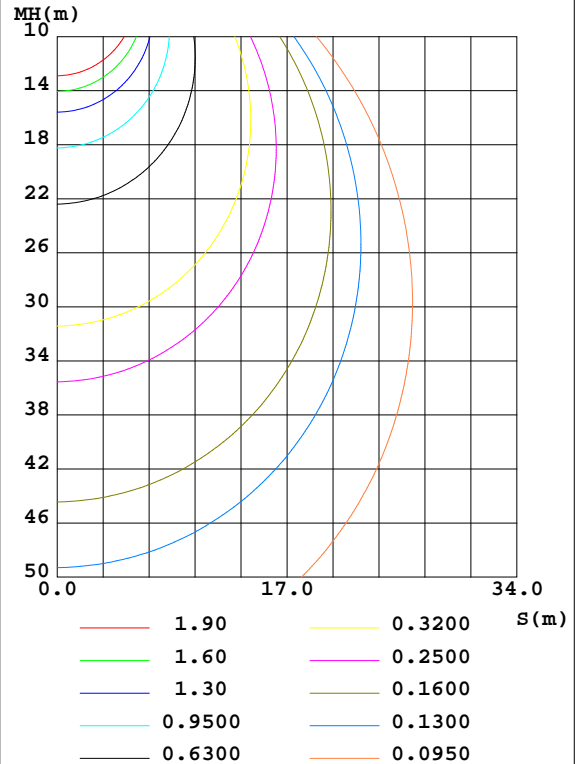

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.519m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum
10	306.9	307.4	308.1	308.8	309.4	309.5	309.0	308.5	0- 10	29.77	29.77	3.78
20	284.5	285.4	286.3	287.8	289.7	289.8	289.0	287.8	10- 20	84.47	114.2	14.5
30	250.0	250.2	251.4	253.8	256.2	256.0	254.6	253.0	20- 30	125.0	239.3	30.4
40	206.2	205.5	206.8	210.3	213.9	213.7	211.5	210.0	30- 40	145.2	384.5	48.8
50	157.4	156.3	156.0	160.8	165.0	165.3	161.6	161.3	40- 50	143.1	527.6	67
60	107.7	105.9	105.2	108.9	114.4	114.4	111.1	111.2	50- 60	120.8	648.4	82.3
70	61.57	59.75	58.70	61.44	66.28	66.28	64.03	64.47	60- 70	85.16	733.6	93.2
80	21.47	20.38	19.75	20.86	24.35	24.47	23.58	23.80	70- 80	44.10	777.7	98.8
90	0.0268	0.1603	0.1493	0.3391	0.3533	0.3444	0.2094	0.2550	80- 90	9.352	787.0	99.9
100	0.0004	0	0.0272	0	0	0	0	0	90-100	0.0541	787.1	100
110	0.0207	0.0177	0.0258	0.0238	0	0	0	0	100-110	0.0050	787.1	100
120	0.0460	0.0456	0.0499	0.0495	0.0287	0.0309	0.0296	0.0294	110-120	0.0203	787.1	100
130	0.0670	0.0709	0.0735	0.0724	0.0874	0.0901	0.0901	0.0895	120-130	0.0519	787.1	100
140	0.0961	0.0992	0.1027	0.0994	0.1385	0.1420	0.1429	0.1424	130-140	0.0779	787.2	100
150	0.1261	0.1301	0.1328	0.1292	0.1705	0.1771	0.1785	0.1743	140-150	0.0854	787.3	100
160	0.1472	0.1484	0.1526	0.1519	0.1810	0.1843	0.1882	0.1853	150-160	0.0744	787.4	100
170	0.1577	0.1594	0.1623	0.1604	0.1873	0.1873	0.1886	0.1878	160-170	0.0484	787.4	100
180	0.1679	0.1704	0.1755	0.1671	0.1675	0.1674	0.1725	0.1730	170-180	0.0166	787.4	100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 457.67 lm

%lum = 58.1%

%lamp = 58.1%

Conical surface Flux(120deg): 648.39 lm


%lum = 82.3%

%lamp = 82.3%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Oliver
 Test Date:2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.428
 Humidity:65.0%
 Test Distance:2.519m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

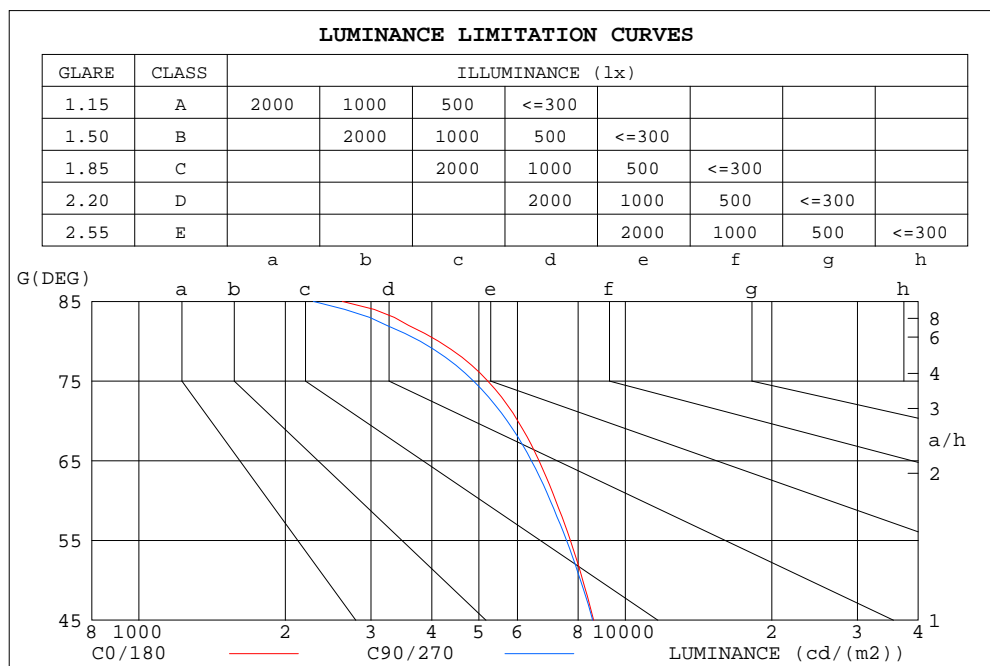


LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	2620	2284
80	4130	3790
75	5216	4877
70	6013	5719
65	6649	6412
60	7192	7012
55	7713	7572
50	8178	8088
45	8605	8570

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.519m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.05	1.01	.97	1.03	.99	.96	.98	.95	.93	.95	.92	.90	.91	.89	.87	.85
2.0	.92	.86	.80	.90	.84	.79	.87	.82	.77	.83	.79	.76	.80	.77	.74	.72
3.0	.81	.74	.67	.80	.73	.67	.77	.71	.65	.74	.69	.64	.72	.67	.63	.61
4.0	.72	.64	.57	.71	.63	.57	.69	.62	.56	.66	.60	.55	.64	.59	.55	.53
5.0	.65	.56	.50	.64	.56	.49	.62	.54	.49	.60	.53	.48	.58	.52	.48	.46
6.0	.59	.50	.44	.58	.49	.43	.56	.49	.43	.54	.48	.43	.53	.47	.42	.40
7.0	.53	.45	.39	.52	.44	.39	.51	.44	.38	.50	.43	.38	.48	.42	.38	.36
8.0	.49	.40	.35	.48	.40	.35	.47	.40	.34	.45	.39	.34	.44	.38	.34	.32
9.0	.45	.37	.31	.44	.37	.31	.43	.36	.31	.42	.36	.31	.41	.35	.31	.29
10.0	.41	.34	.28	.41	.33	.28	.40	.33	.28	.39	.33	.28	.38	.32	.28	.26

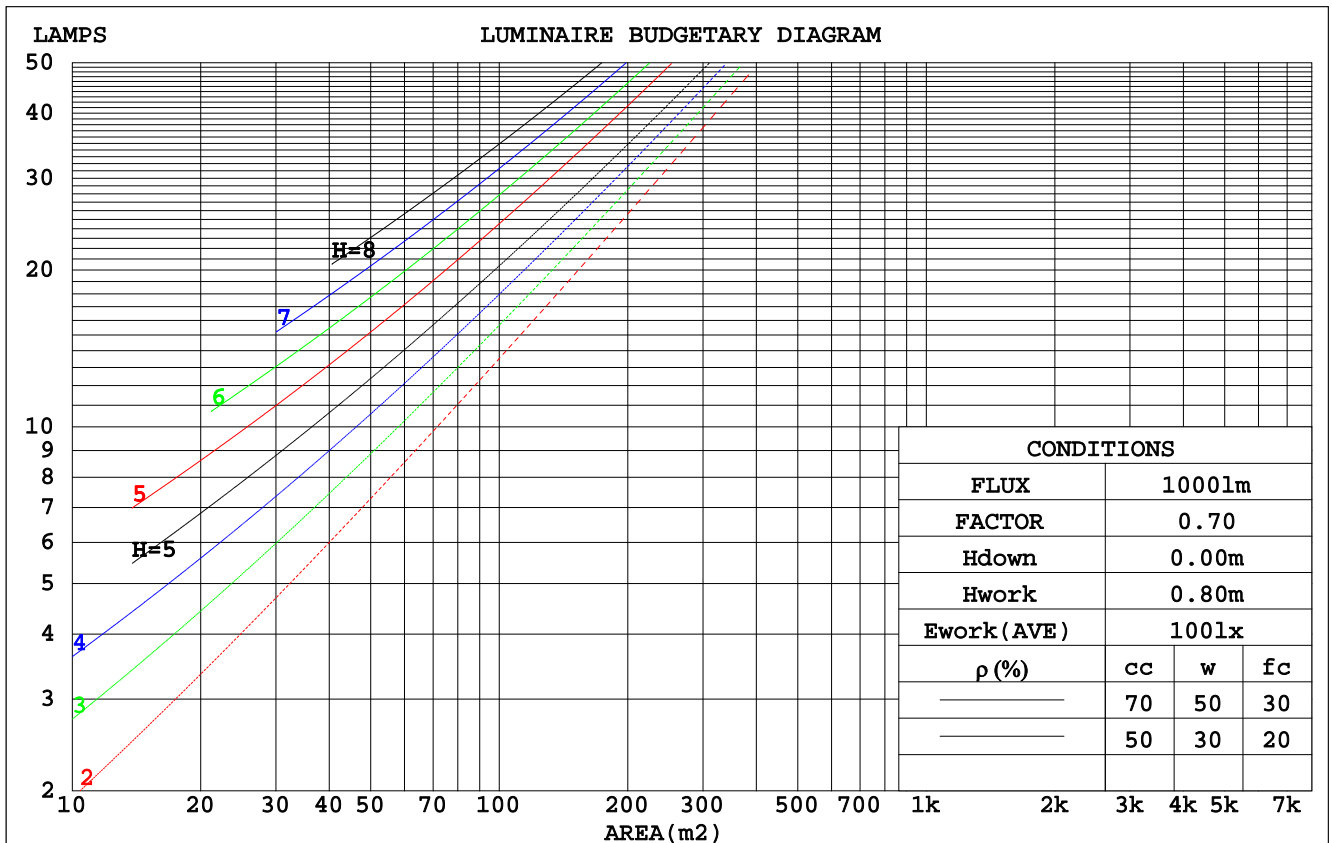

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.519m [K=1.0000]
 Remarks:

WEC AND CCEC

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.289	.164	.052	.282	.161	.051	.269	.154	.049	.257	.148	.048	.246	.142	.046	
2.0	.276	.151	.046	.269	.148	.046	.258	.143	.045	.247	.139	.043	.237	.134	.042	
3.0	.257	.137	.041	.252	.135	.041	.242	.131	.040	.232	.127	.039	.223	.124	.038	
4.0	.239	.124	.036	.234	.123	.036	.225	.119	.036	.217	.116	.035	.209	.113	.035	
5.0	.222	.113	.033	.218	.112	.033	.210	.109	.032	.202	.107	.032	.195	.104	.031	
6.0	.207	.104	.030	.203	.102	.029	.196	.100	.029	.189	.098	.029	.183	.096	.029	
7.0	.193	.095	.027	.190	.094	.027	.183	.093	.027	.177	.091	.026	.172	.089	.026	
8.0	.181	.088	.025	.178	.087	.025	.172	.086	.025	.167	.084	.024	.162	.083	.024	
9.0	.170	.082	.023	.167	.081	.023	.162	.080	.023	.157	.079	.023	.152	.077	.022	
10.0	.160	.077	.021	.158	.076	.021	.153	.075	.021	.148	.074	.021	.144	.073	.021	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.191	.191	.191	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.179	.157	.136	.153	.135	.117	.105	.093	.081	.060	.054	.047	.019	.017	.015	
2.0	.171	.132	.100	.146	.114	.087	.100	.079	.061	.058	.046	.035	.019	.015	.012	
3.0	.162	.115	.077	.139	.099	.066	.096	.069	.047	.055	.040	.027	.018	.013	.009	
4.0	.155	.101	.060	.133	.087	.052	.091	.061	.037	.053	.036	.022	.017	.012	.007	
5.0	.147	.091	.049	.127	.078	.042	.087	.055	.030	.051	.032	.018	.016	.011	.006	
6.0	.140	.082	.041	.121	.071	.035	.083	.050	.025	.048	.029	.015	.016	.010	.005	
7.0	.134	.075	.034	.115	.065	.030	.079	.046	.021	.046	.027	.013	.015	.009	.004	
8.0	.127	.069	.030	.110	.060	.026	.076	.042	.018	.044	.025	.011	.014	.008	.004	
9.0	.121	.065	.026	.105	.056	.023	.072	.039	.016	.042	.023	.010	.014	.008	.003	
10.0	.116	.060	.023	.100	.052	.020	.069	.037	.014	.040	.022	.009	.013	.007	.003	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.519m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	19.7	21.2	20.0	21.4	21.6	19.6	21.1	19.9	21.3	21.5
3H	21.0	22.3	21.2	22.5	22.8	20.8	22.1	21.1	22.4	22.6
4H	21.4	22.7	21.7	22.9	23.2	21.2	22.5	21.5	22.7	23.0
6H	21.7	22.9	22.0	23.1	23.4	21.4	22.6	21.7	22.9	23.2
8H	21.7	22.9	22.1	23.2	23.4	21.5	22.6	21.8	22.9	23.2
12H	21.7	22.8	22.1	23.1	23.4	21.5	22.6	21.8	22.9	23.2
4H 2H	20.2	21.5	20.5	21.7	22.0	20.1	21.4	20.4	21.6	21.9
3H	21.6	22.7	22.0	23.0	23.3	21.5	22.6	21.8	22.9	23.2
4H	22.2	23.2	22.5	23.5	23.8	22.0	23.0	22.4	23.3	23.6
6H	22.5	23.4	22.9	23.8	24.2	22.3	23.2	22.7	23.6	23.9
8H	22.6	23.5	23.0	23.8	24.2	22.4	23.2	22.8	23.6	24.0
12H	22.7	23.4	23.1	23.8	24.2	22.4	23.2	22.8	23.6	24.0
8H 4H	22.3	23.2	22.8	23.5	23.9	22.2	23.0	22.6	23.4	23.8
6H	22.8	23.5	23.2	23.9	24.3	22.6	23.3	23.0	23.7	24.1
8H	22.9	23.6	23.4	24.0	24.4	22.7	23.3	23.2	23.8	24.2
12H	23.0	23.5	23.5	24.0	24.5	22.8	23.3	23.2	23.7	24.2
12H 4H	22.3	23.1	22.8	23.5	23.9	22.2	22.9	22.6	23.3	23.7
6H	22.8	23.4	23.3	23.9	24.3	22.6	23.2	23.1	23.7	24.1
8H	23.0	23.5	23.5	24.0	24.4	22.8	23.3	23.2	23.7	24.2
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.2 / - 0.3					+ 0.2 / - 0.3				
1.5H	+ 0.2 / - 0.3					+ 0.2 / - 0.3				
2.0H	+ 0.3 / - 0.3					+ 0.4 / - 0.3				

CIE Pub.117, 787.4 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -0.8)

Area: 0.03 m2

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.519m [K=1.0000]
 Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	60	49	42	59	48	42	58	48	42	35
0.80	70	59	52	69	58	52	67	58	51	45
1.00	78	68	61	77	67	61	75	68	60	53
1.25	85	75	69	84	75	68	81	73	67	60
1.50	90	81	74	88	80	74	86	78	73	65
2.00	97	89	83	95	87	82	91	85	80	73
2.50	100	93	87	98	92	86	95	89	85	77
3.00	103	97	92	101	96	91	97	93	89	80
4.00	107	102	98	105	100	96	101	97	94	85
5.00	109	105	101	107	103	100	103	99	97	88
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.519m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

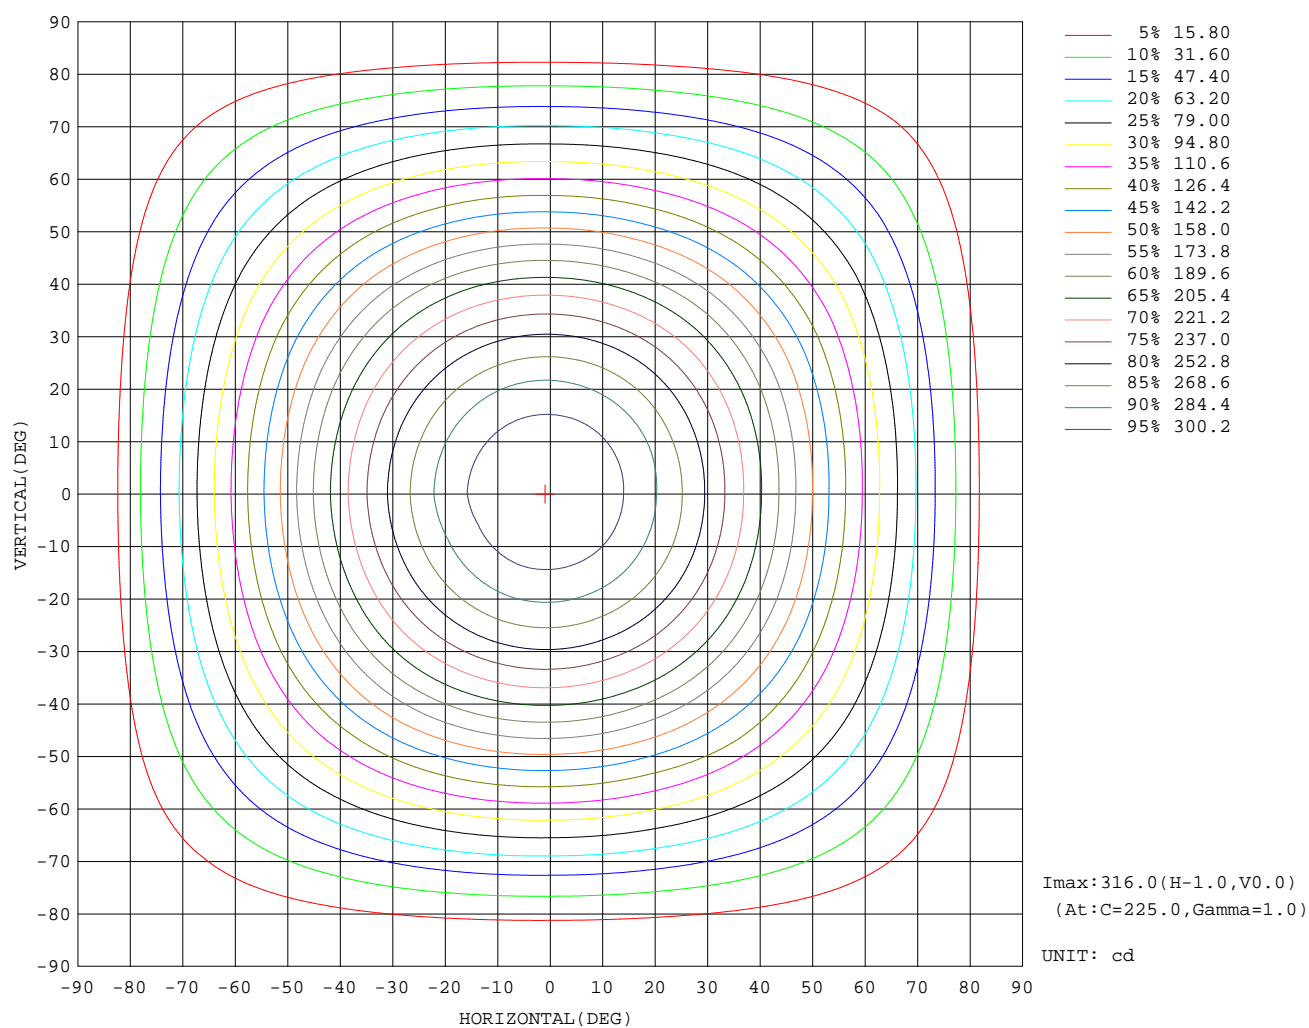

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.519m [K=1.0000]
Remarks:


AAI Figure

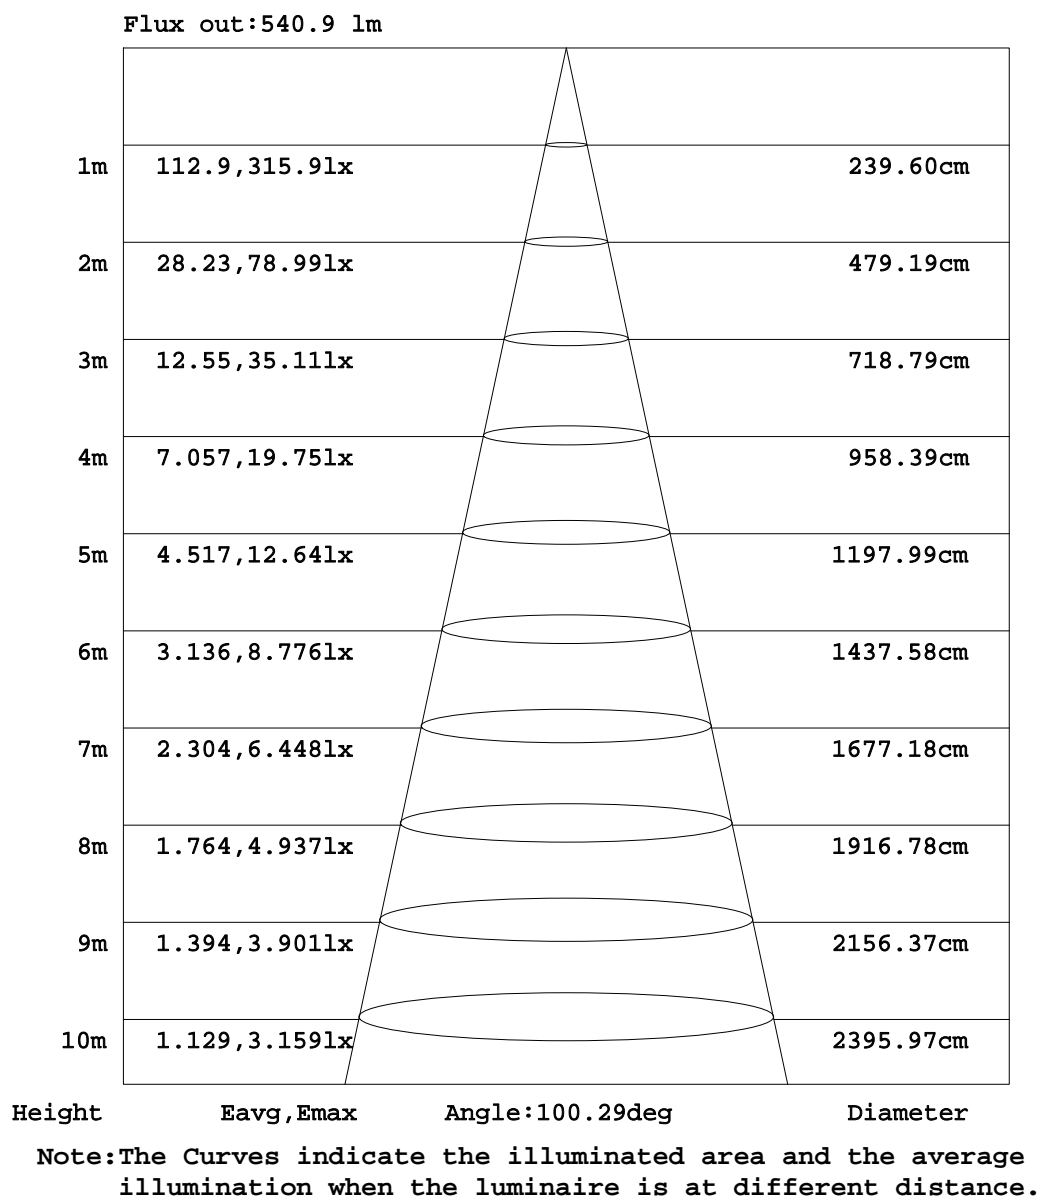

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.519m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

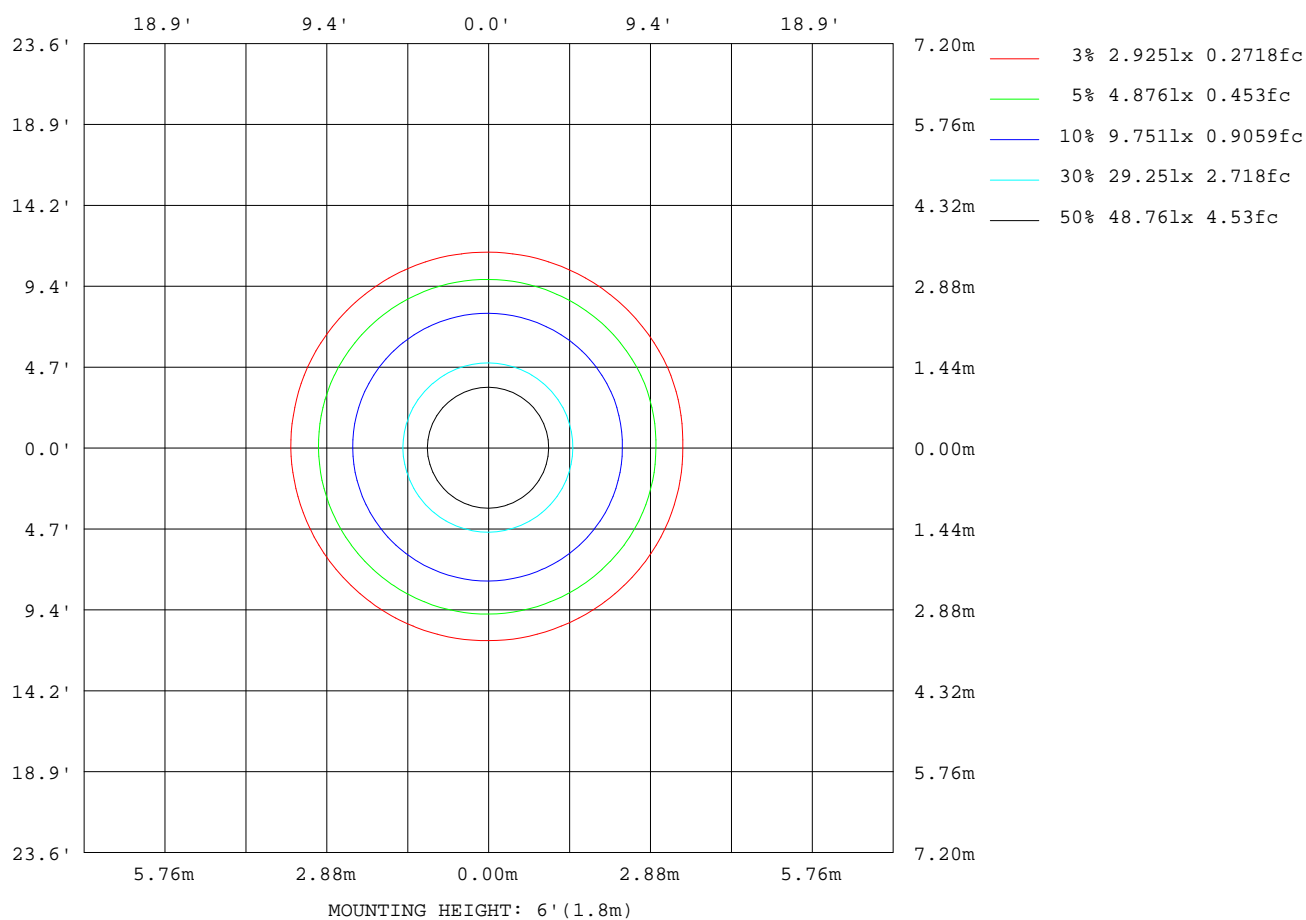

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2022-11-22

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.519m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:26.907V I:0.3003A P:8.0811W PF:1.0000 Freq:0Hz UTHDi:0.00% ITHDi:0.00% Lamp Flux:787.438x1 lm		
NAME: 线条灯300mA-6500K	TYPE: Surface-mounted Luminaire	HEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	6861
L_0~180(75)av	5446
L_0~180(85)av	2873
L_90~270(65)av	6639
L_90~270(75)av	5179
L_90~270(85)av	2664
L_45(65)av	6779
L_45(75)av	5346
L_45(85)av	2788

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Oliver
Test Date:2022-11-22

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.428
Humidity:65.0%
Test Distance:2.519m [K=1.0000]
Remarks:

Planar Illuminance Curve

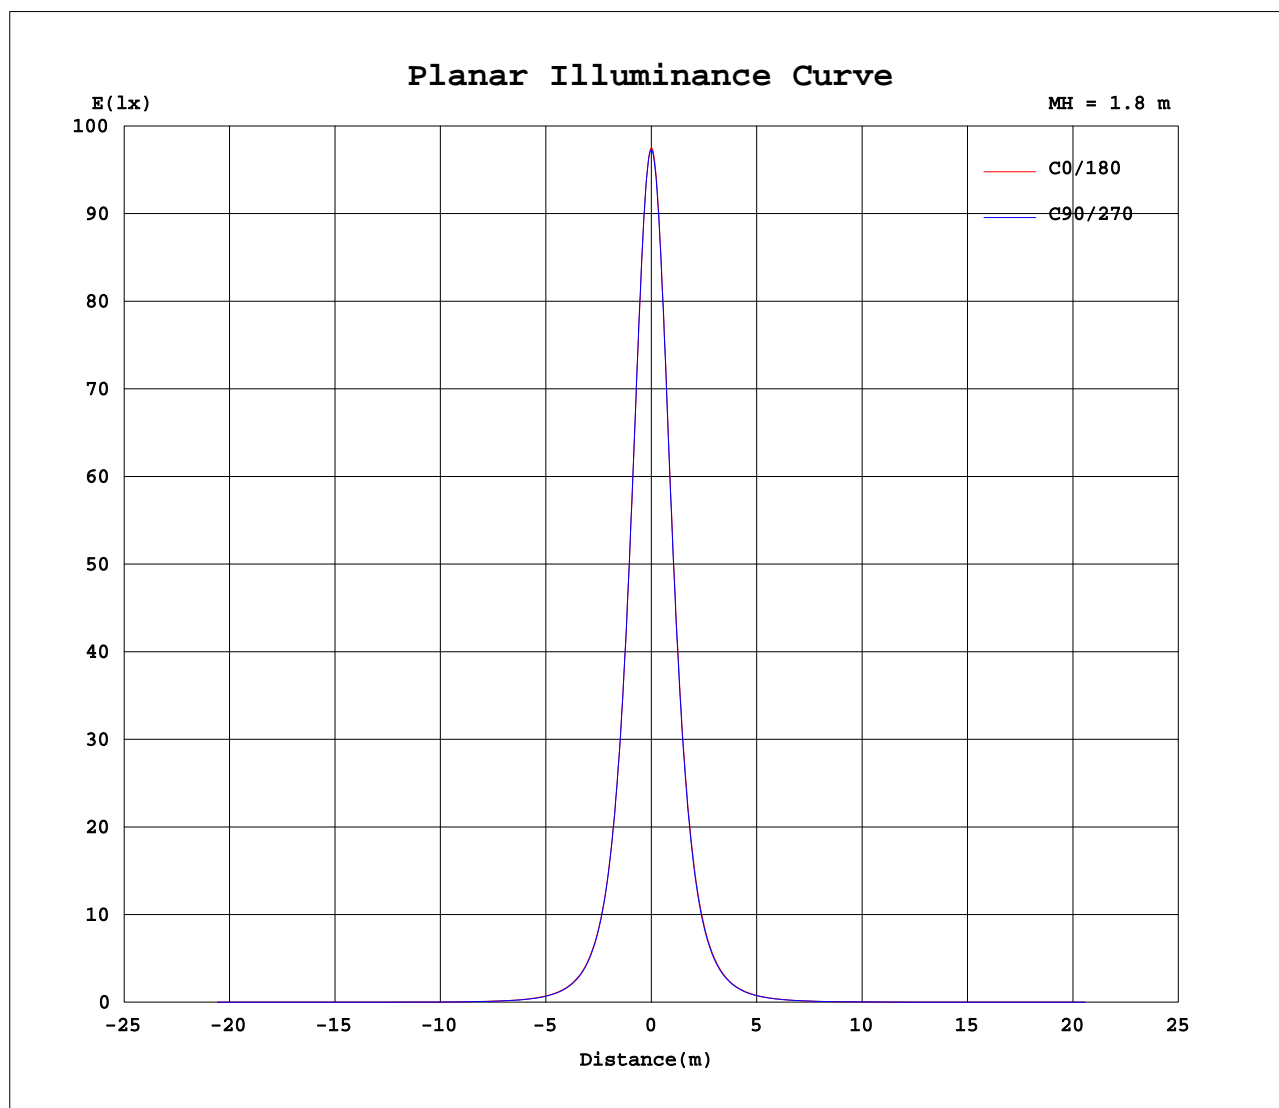

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Oliver
Test Date: 2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.428
Humidity: 65.0%
Test Distance: 2.519m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	315	315	315	315	315	315	315	315	315	315	315	315	315	315	315	315			
5	313	313	313	313	313	314	314	314	314	314	314	314	314	314	314	313			
10	307	307	307	308	308	309	309	309	309	309	310	309	309	309	309	308			
15	297	298	298	298	299	300	300	300	301	301	301	301	301	300	300	299			
20	285	285	285	286	286	287	288	288	290	290	290	290	289	288	288	287			
25	269	269	269	269	270	271	272	273	274	274	274	273	273	272	271	270			
30	250	250	250	250	251	253	254	255	256	256	256	255	255	254	253	252			
35	229	229	229	229	230	231	233	235	236	236	236	235	234	233	232	231			
40	206	206	205	206	207	208	210	212	214	214	214	213	212	211	210	209			
45	182	182	181	181	182	184	186	188	190	190	190	189	187	186	186	185			
50	157	157	156	155	156	158	161	163	165	166	165	164	162	161	161	161			
55	132	132	131	130	130	132	135	138	140	141	140	138	136	135	136	136			
60	108	108	106	105	105	107	109	112	114	116	114	113	111	110	111	112			
65	84.1	83.9	82.2	81.1	81.3	82.9	84.6	87.2	89.8	90.9	89.7	88.5	87.0	86.6	87.3	87.7			
70	61.6	61.2	59.8	58.6	58.7	59.9	61.4	63.5	66.3	67.1	66.3	65.3	64.0	63.9	64.5	64.7			
75	40.4	39.9	38.9	37.9	37.9	38.7	39.9	41.4	44.2	44.8	44.2	43.5	42.5	42.5	43.0	43.1			
80	21.5	21.1	20.4	19.8	19.7	20.2	20.9	21.9	24.3	24.7	24.5	24.1	23.6	23.5	23.8	23.8			
85	6.84	6.52	6.34	6.01	5.97	6.16	6.43	6.82	8.19	8.39	8.25	8.22	7.96	7.99	8.14	8.03			
90	0.03	0.11	0.16	0.15	0.15	0.23	0.34	0.36	0.35	0.42	0.34	0.28	0.21	0.23	0.26	0.21			
95	0.00	0.00	0.00	0.03	0.06	0.07	0.06	0.02	0.06	0.00	0.00	0.03	0.02	0.01	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.03	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.01	0.00	0.01	0.01	0.02	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.02	0.01	0.02	0.02	0.03	0.02	0.02	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.04	0.02	0.03	0.03	0.04	0.03	0.03	0.03	0.01	0.01	0.01	0.00	0.01	0.01	0.01	0.01			
120	0.05	0.04	0.05	0.04	0.05	0.05	0.05	0.04	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03			
125	0.06	0.05	0.06	0.06	0.06	0.06	0.06	0.05	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06			
130	0.07	0.07	0.07	0.07	0.07	0.07	0.07	0.07	0.09	0.09	0.09	0.09	0.09	0.09	0.09	0.09			
135	0.08	0.08	0.09	0.09	0.09	0.09	0.09	0.08	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12			
140	0.10	0.10	0.10	0.10	0.10	0.10	0.10	0.10	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14			
145	0.11	0.11	0.11	0.11	0.12	0.12	0.11	0.11	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16			
150	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.17	0.17	0.18	0.18	0.18	0.18	0.17	0.17			
155	0.14	0.14	0.14	0.15	0.15	0.15	0.14	0.14	0.18	0.18	0.18	0.18	0.19	0.18	0.18	0.18			
160	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.18	0.18	0.18	0.19	0.19	0.19	0.19	0.18			
165	0.15	0.15	0.15	0.16	0.16	0.16	0.15	0.15	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19			
170	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19			
175	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18			
180	0.17	0.17	0.17	0.18	0.18	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Oliver
 Test Date: 2022-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.428
 Humidity: 65.0%
 Test Distance: 2.519m [K=1.0000]
 Remarks: